



FEDERAL PLAZA EAST ELEVATION 1

SCALE: 1/2" = 1'-0"

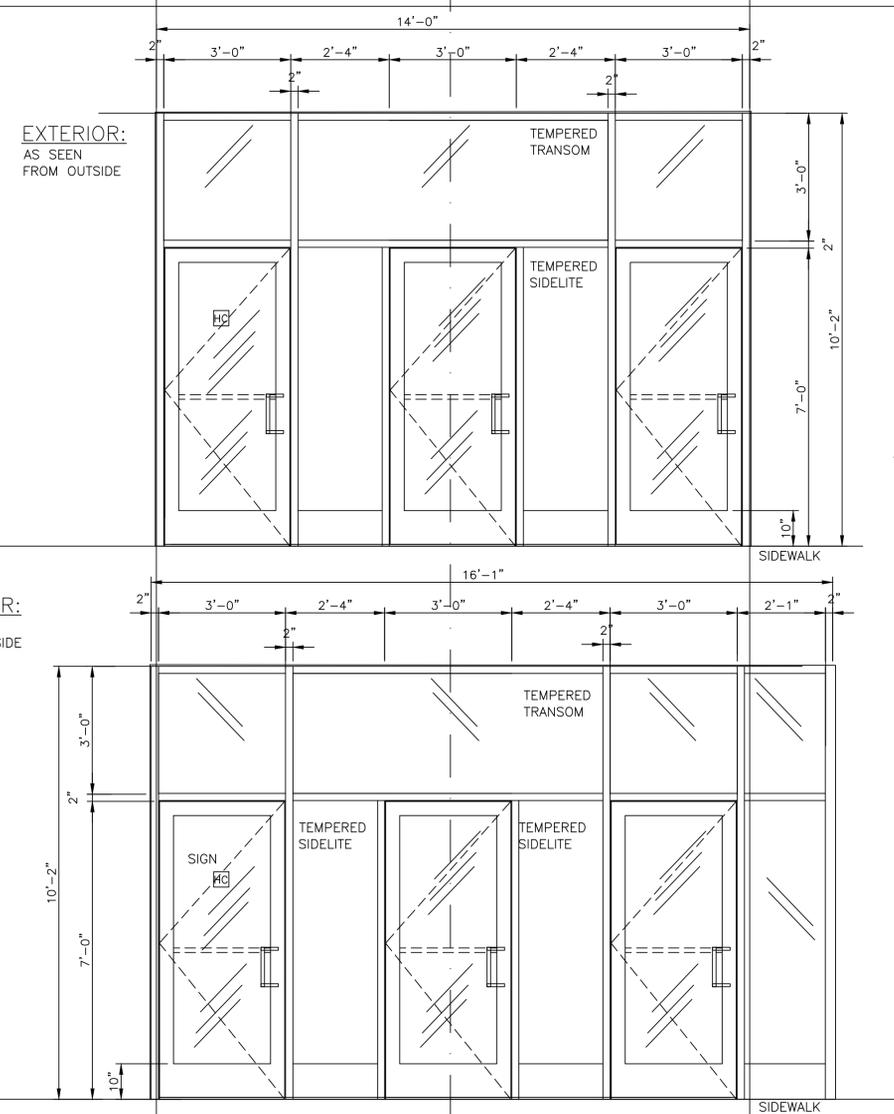

FEDERAL PLAZA WEST ELEVATION 2

SCALE: 1/2" = 1'-0"

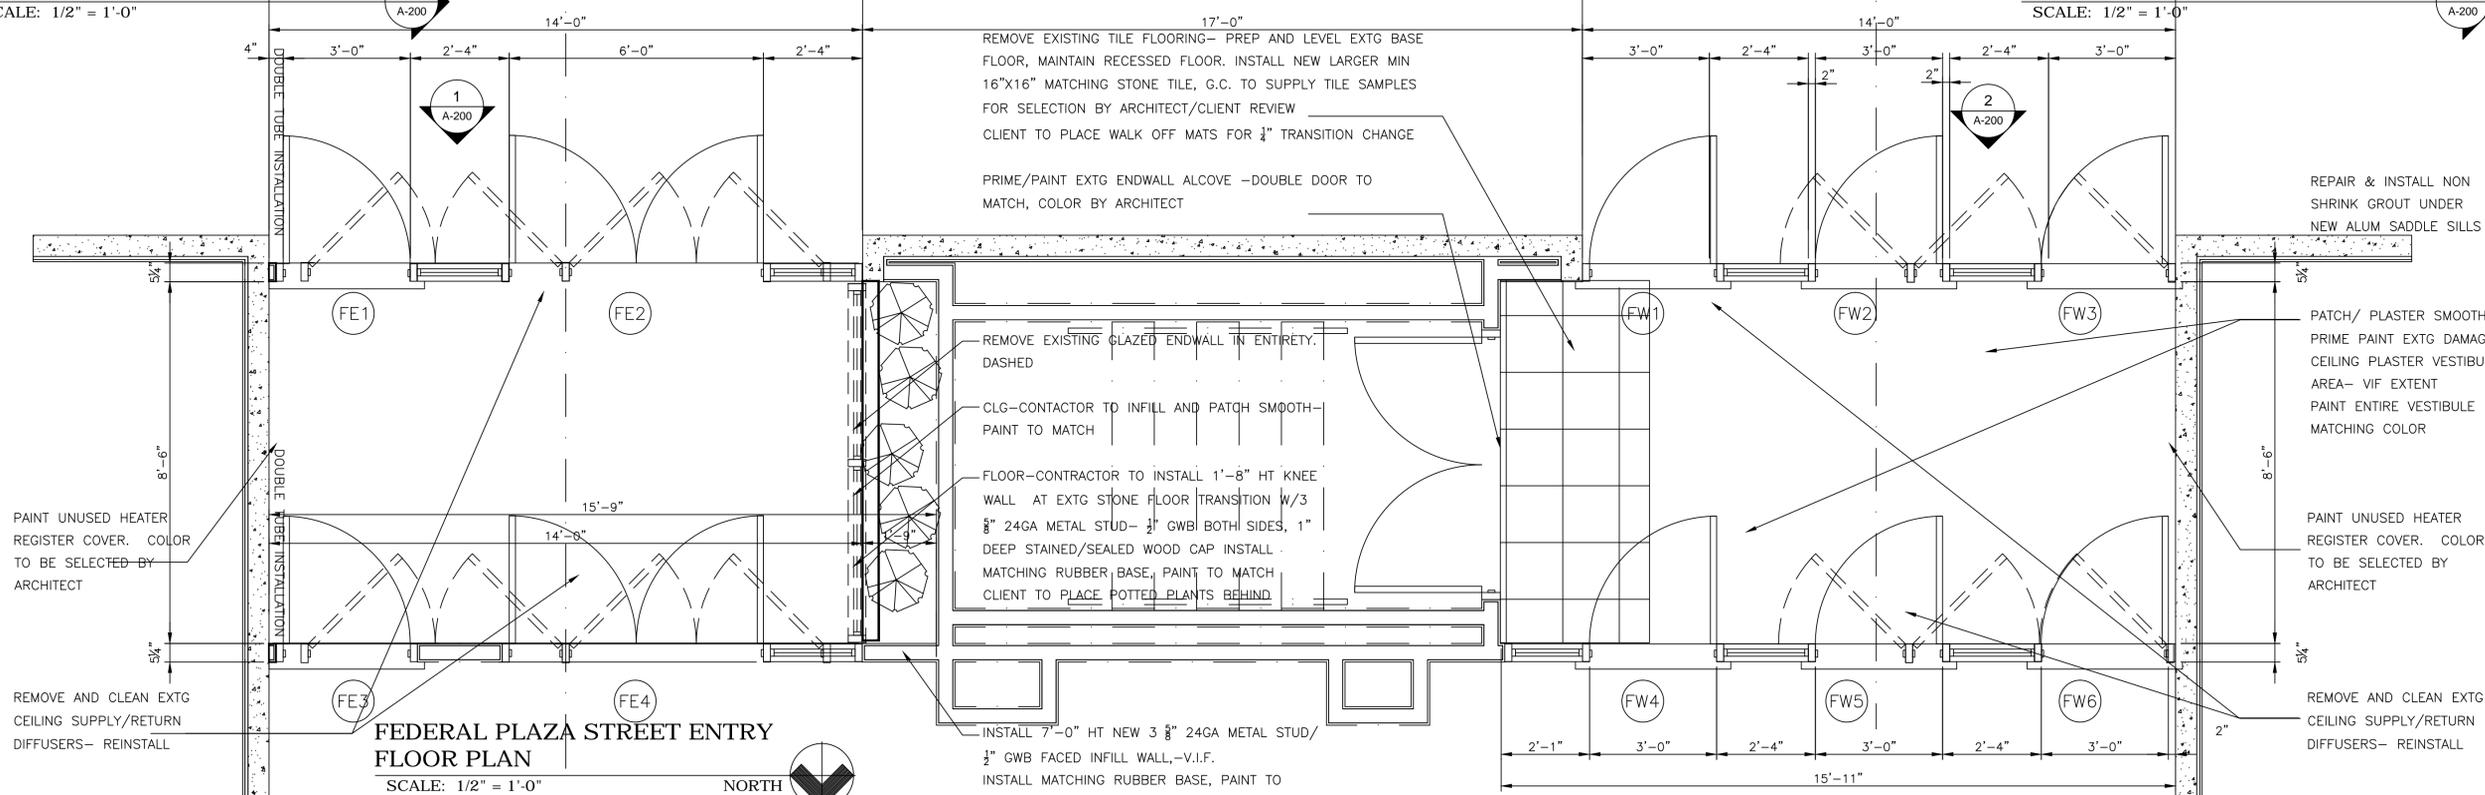


FEDERAL PLAZA STREET ENTRY FLOOR PLAN

SCALE: 1/2" = 1'-0"

NORTH

**RELEASE FOR BID/
CODE REVIEW
11-2-2015**



Corporate Center:
1424 Market Street
North Lima, Ohio 44452
Post Office Box 332
Tel: 330.549.0011
Fax: 330.549.0012
Cell (Sipp) : 724.544.8160 Cell (Tepe) : 330.651.7543

S + T] ARCH
SIPP + TEPE ARCHITECTS, L.L.C.
Licensed and Registered:
OH., PA., TEXAS, W.VA.

A NEW STOREFRONT ENTRIES FOR:
FEDERAL PLACE BUILDING
GROUND FLOOR ENTRIES
20 West Federal Place
City of Youngstown, Mahoning County, Ohio 44503
Contact Person: Sean McKinney 330-742-8995

PROJECT

RELEASE DATE: OCT 21, 2015

SEAL



DOUGLAS DONALD SIPP, AIA
LICENSE # 10534
EXPIRATION DATE 12/31/2015


**STOREFRONT PROPOSAL PLANS:
FEDERAL ST**

DRAWING TITLE
DRAWING NUMBER


A-200

ESTABLISHED- 1997
COPYRIGHT RESERVED- 2015

NO.	REVISION	DATE

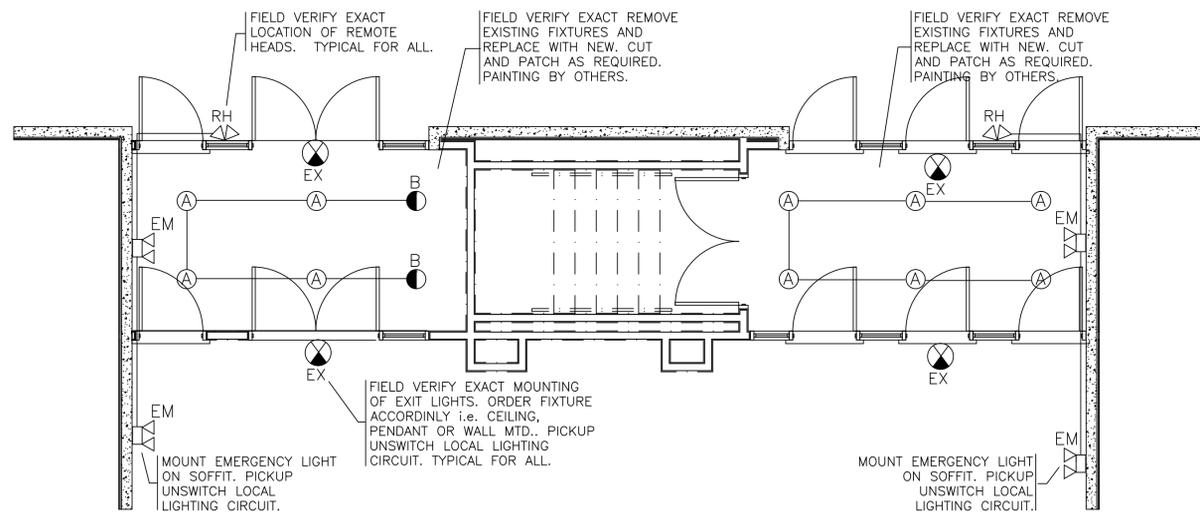

SOUTH FOYER
1/4"=1'

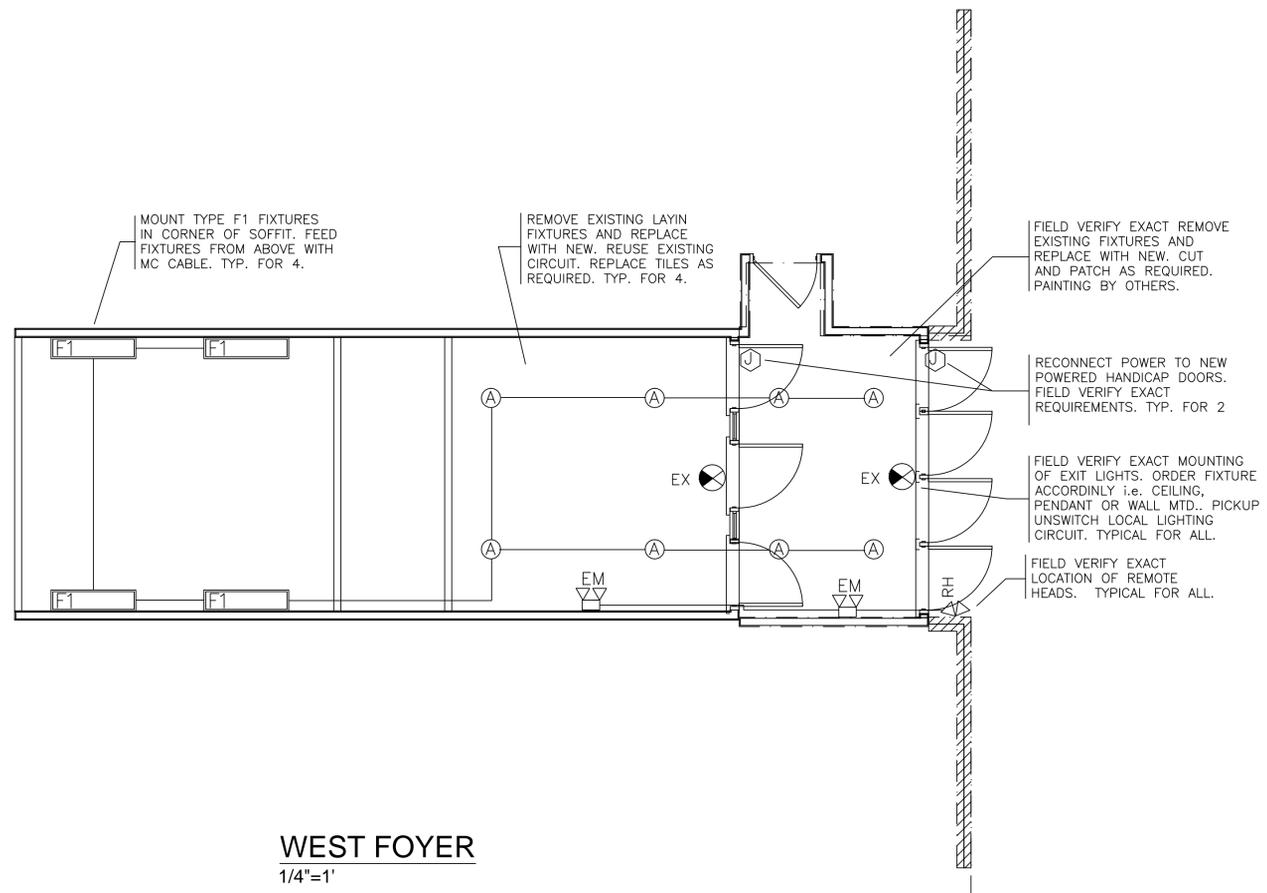

WEST FOYER
1/4"=1'

GENERAL ELECTRICAL SPECIFICATIONS:

GENERAL:

1. ALL ELECTRICAL WORK IS TO BE IN ACCORDANCE WITH NFPA 70-2014 AND ALL APPLICABLE NATIONAL, STATE AND LOCAL CODES.
2. ALL WORK IS TO BE DONE IN A WORKMAN LIKE MANNER.
3. IF APPLICABLE, ELECTRICAL DEMOLITION IS TO BE BY E.C.
4. IF APPLICABLE, CUTTING AND PATCHING FOR ELECTRICAL WORK IS TO BE BY E.C.
5. IF APPLICABLE, TEMPORARY POWER AND LIGHTING IS TO BE BY E.C.
6. ELECTRICAL PERMITS AND ASSOCIATED COST ARE TO BE BY E.C.
7. ALL ELECTRICAL WORK, EXCEPT LAMPS, IS TO BE GUARANTEED FOR THE PERIOD OF ONE YEAR AFTER ACCEPTANCE.
8. THE E.C. IS TO MAKE A SITE VISIT TO DETERMINE EXISTING CONDITIONS. IF EXISTING CONDITIONS ARE NOT AS REPRESENTED ON THE DRAWINGS THE E.C. IS TO NOTIFY THE ENGINEER PRIOR TO BIDDING.
9. DRAWINGS ARE DIAGRAMMATIC IN NATURE AND INDICATE ONLY THE GENERAL ARRANGEMENT. SEE ARCHITECTURAL DRAWINGS FOR EXACT DIMENSIONS.
10. COORDINATE ALL WORK WITH ALL OTHER TRADES.

LIGHTING:

1. ALL LIGHT FIXTURES ARE TO BE NEW UNLESS OTHERWISE NOTED.
2. ALL LIGHT FIXTURES AND LAMPS ARE TO BE IN GOOD WORKING CONDITION WHEN TURNED OVER TO OWNER.
3. SECURELY MOUNT LIGHT FIXTURES AS REQUIRED BY CODE AND LOCAL INSPECTORS AS PER NEC 410-36.
4. MAINTAIN FIRE RATING OF ALL CEILINGS. TENT FIXTURES IF REQUIRED.


MATERIALS:

1. ALL MATERIAL IS TO BE UL LISTED AND USED ONLY FOR THE PURPOSE FOR WHICH IT IS LISTED.
2. TYPE NM IS ALLOWED IN DWELLING UNITS ONLY AS PERMITTED BY NEC.
3. TYPE MC AND AC CABLES ARE ACCEPTABLE WHERE PERMITTED BY CODE.
4. ALL WIRE IS TO BE THWN COPPER RATED FOR 600V UNLESS OTHERWISE NOTED.
5. ALL WIRE IS TO BE #12 MINIMUM.
6. NO FEEDER SHALL EXCEED 2% VOLTAGE DROP. NO BRANCH CIRCUIT SHALL EXCEED 3% VOLTAGE DROP AT THE FARTHEST OUTLET.
7. WHEN A 20A CIRCUIT EXCEEDS 100 FEET FROM THE PANEL THE CONDUCTORS ARE TO BE INCREASED TO #10 THWN.
8. PVC IS TO BE USED UNDERGROUND ONLY, MINIMUM SCHEDULE 40. ALL ELBOWS ARE TO BE SCHEDULE 80 OR GRMC.
9. EXTERIOR EXPOSED CONDUITS ARE TO BE RIGID METALLIC CONDUIT.
10. SERVICE ENTRANCE CONDUITS ARE TO BE RIGID METALLIC CONDUIT.
11. FLEXIBLE METAL CONDUIT (FMC) OR LIQUIDTIGHT FMC IS TO BE LIMITED TO 6'.
12. ALL CONDUITS ARE TO BE RUN CONCEALED WHERE POSSIBLE. ALL NEW CONSTRUCTION CONDUITS ARE TO BE RUN IN THE WALLS INCLUDING BRICK AND BLOCK.
13. PROVIDE A PULL WIRE IN ALL EMPTY CONDUITS.

FIXTURE SCHEDULE

MARK	DESCRIPTION	CATALOG NUMBER	NO. OF LAMPS	LAMP TYPE	VOLT	WATTS	REMARKS
F1	4' - LED 45 DEGREE WALL BRACKET	LUMINARIRE LED VPF84503500K120CPWHTCOR	-	INCLUDED	120	49	
A	6" LED RECESSED DOWNLIGHT	PRESCOLITE LB6LEDA10L	1	INCLUDED	120	12	
B	2INCH LED CAN CLEAR REFLECTOR WALL WASHER WHITE TRIM WIDE FLOOD	PRESCOLITE D2LED-2D9LED12L35K8WWWWT	--	1200 LUMEN 35K	120	24	
EX	EXIT LIGHT- LED W/BATTERY EDGE LIGHT W/GREEN LETTERS	MULE PVT1BGUBA	--	INCLUDED	120		CONNECT TO LOCAL UNSWITCHED LIGHTING CIRCUIT
EM	EMERGENCY LIGHT BLACK WALL MOUNTED DECORATIVE W/REMOTE CAPABILITY	HUBBELL EVR4B	2	INCLUDED	120		CONNECT TO LOCAL UNSWITCHED LIGHTING CIRCUIT
RH	DUAL REMOTE HEAD LED BLACK WALL MOUNTED	HUBBELL EVOB	2	INCLUDED	3.6		CONNECT TO NEAREST EXIT LIGHT W/ REMOTE POWER

S. A. Engineering
23 Lisbon Street, Suite G
Canfield, OH 44406
Tel. (330) 533-4983
www.saeengineeringinc.com



SHEET TITLE

PHARMOR BUILDING
20 FEDERAL PLAZA
YOUNGSTOWN OHIO 44501

SCALE
1/4"=1'

DATE
10/22/15

SHEET NAME

FOYER LIGHTING

SHEET No.

F1